


STANDARD DRAWINGS		
CULVERT TRENCH BACKFILLING SPECIFICATIONS		
DATE CREATED: 28/10/15	DRG. NO: SD6-10A	REV: A

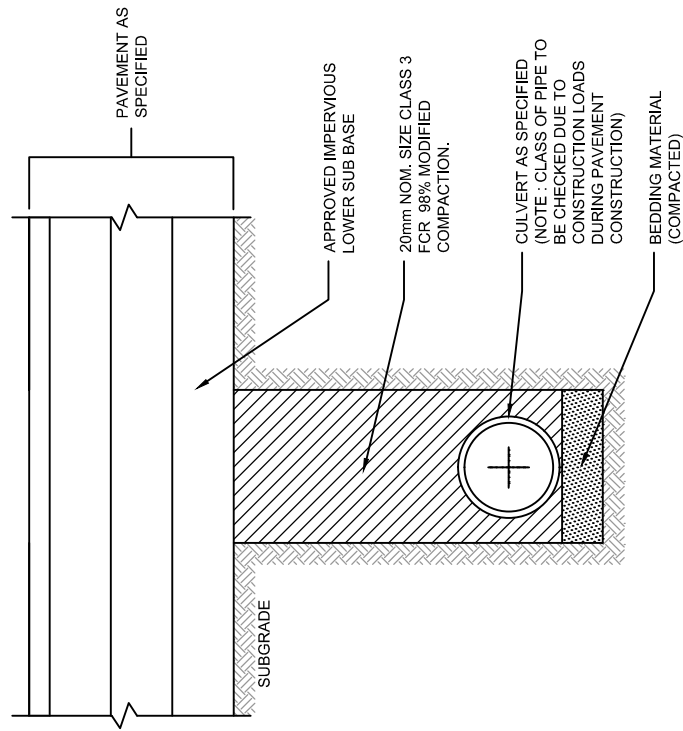

TYPICAL CROSS SECTION
UNDER PAVEMENT

1. COMPACTION TESTS TO BE UNDERTAKEN BY A NATA REGISTERED TESTER FOR SEWER AND DRAINAGE TRENCH BACKFILL, AND THE RESULTS FORWARDED TO WENTWORTH SHIRE COUNCIL'S CONSTRUCTION SUPERVISOR.
2. TRENCH WIDTH = PIPE OUTSIDE DIAMETER + 300mm.
3. IF TRENCH IS IN/THROUGH EXISTING PAVEMENT, REINSTATEMENT WIDTH OF PAVEMENT IS:
WEARING COURSE = TRENCH WIDTH + 500mm EACH SIDE OF TRENCH.