


NOTE:

1. ALL TAPPINGS ARE TO BE CARRIED OUT BY COUCIL.
2. IF METER IS TO BE PLACED BELOW GROUND LEVEL THEN THE INSTALLATION IS TO COMPLY WITH AS 35000.1 AND BE APPROVED BY THE ENGINEER.
3. ROAD OPENING AND A TRAFFIC PLAN IS TO BE OBTAINED/ PRESENTED TO COUNCIL BEFORE ANY WORK COMMENCES ON SITE.
4. MINIMUM COVER IN PUBLIC AREAS TO BE 450 MM.
5. PLUMBING TO BE SUPPLIED BY OWNERS LICENCED PLUMBERS.
6. ALL ROAD CROSSINGS SHALL BE SLEEVED IN ACCORDANCE WITH COUNCIL SPECIFICATIONS.

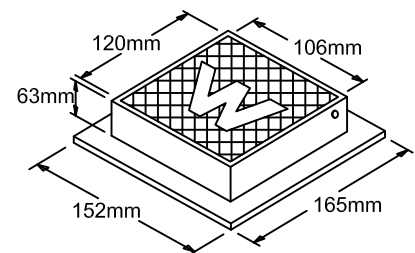

PATH BOX DETAIL
(N.S.W.)