


NOTE:

1. BOLLARDS TO BE OFFSET AT LEAST 1000mm FROM BACK OF KERB.
2. ALL DIMENSIONS ARE IN MILLIMETRES.
3. MINIMUM CONCRETE STRENGTH OF 25MPa AT 28 DAYS.

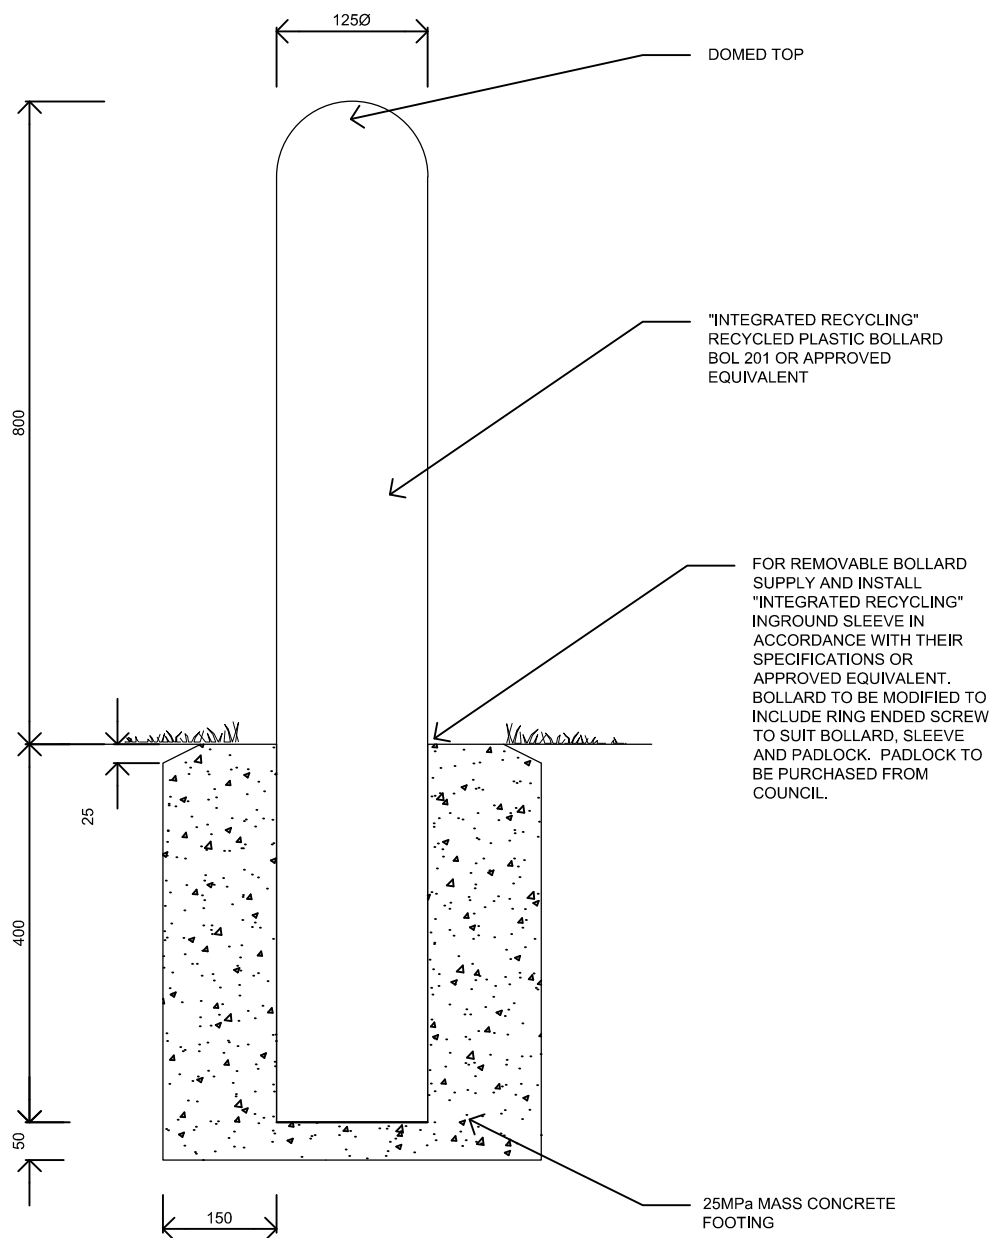

ELEVATION

Drawing name: E:\my documents\work\jobs\3WC\standards development\standard drawings\SD10-1 REV A.dwg (06 Nov, 2015)

A	2/11/15	ORIGINAL ISSUE	S.W.	S.P.	
REV.	DATE	REVISION DESCRIPTION	DRN.	APPD.	

GENERAL NOTES:

1. DRAWING NOT TO BE SCALED.
2. ALL MEASUREMENTS ARE IN MILLIMETRES UNLESS STATED OTHERWISE.
3. FOR UP-TO-DATE DRAWINGS PLEASE CONTACT WENTWORTH SHIRE COUNCIL (WSC) OR CHECK THE WSC WEBSITE.
4. ALL STANDARD DRAWINGS ARE TO BE USED IN CONJUNCTION WITH SD1-1 (STANDARD DRAWINGS CONDITIONS OF USE).

**WENTWORTH  
SHIRE COUNCIL**  
WORTH THE DRIVE

STANDARD DRAWINGS

BOLLARD DETAIL

DATE CREATED:  
23/6/15

DRG. NO:

SD10-1

REV:

A