
SECTION A-A

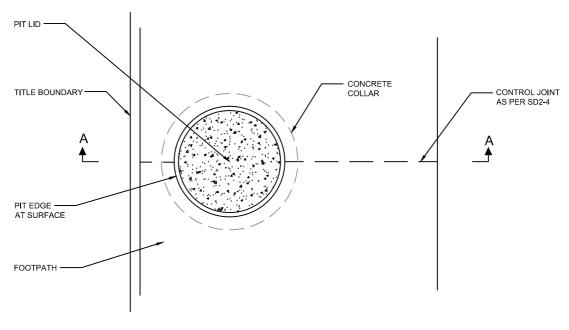

<u>PLAN</u>

NOTES:

- 1. THE SERVICE PIT IS TO BE INSTALLED WITH ITS OUTER EDGE NOT LESS THAN 150mm FROM THE EDGE OF THE FOOTPATH.
- 2. THE CONCRETE COLLAR SUPPORT IS TO BE 200mm THICK WITHIN THE FOOTPATH.
- 3. FOOTPATH REINFORCEMENT TO BE CONTINUOUS ON ALL SIDES OF THE PIT.
- 4. MINIMUM FOOTPATH REINSTATMENT TO BE 1200mm WIDE.
- 5. CONCRETE STRENGTH OF 25MPa AT 28 DAYS.

S/Owo											
ent						WENTWODTH	STANDARD DRAWINGS				
튌						WENTWORTH					
왕						SHIRE COUNCIL	LNCTALLA	TION O		A 1	DIT
ĘĽ	В	14/10/15	NOTES/DIMENSIONS ADDED/AMENDED				INSTALLATION OF ELECTRICAL PIT IN FOOTPATH				
]::	Α	12/5/15	ORIGINAL ISSUE	S.W.	C.L.	WORTH ™ DRIVE					
- 6	REV.	DATE	REVISION DESCRIPTION	DRN.	APPD.						
general notes:											
ត់ l. DRAWING NOT TO BE SCALED.											
	2. ALL MEASUREMENTS ARE IN MILLIMETRES UNLESS STATED OTHERWISE.									1	
깘	3. FOR UP-TO-DATE DRAWINGS PLEASE CONTACT WENTWORTH SHIRE COUNCIL (WSC) OR CHECK THE WSC WEBSITE.						DATE CREATED:	DRG. NO:		REV:	_
ا≽	4 ALL STANDARD DRAWINGS ARE TO BE USED IN CONJUNCTION WITH SD1-1 (STANDARD DRAWINGS CONDITIONS OF								SD2-6		R
الق	USE).						23/2/15		シ レムーひ		ט

Drawing name: E:\my documents\0work\0jobs\3WC\standards development\standard drawings\SD2-6 REV B.dwg (03 Nov, 2015)