



SECTION A - A

SECTION B - B

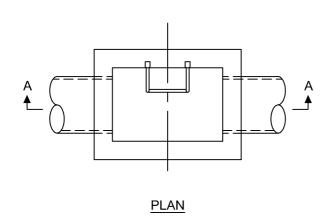



NOTES:

- PITS DEEPER THAN 1000mm TO BE FITTED WITH STEP IRONS.
- STEP IRONS TO BE LOCATED:
 - DIRECTLY BELOW THE OPENING IN THE COVER.
 - DESIRABLY ON A WALL WITHOUT PIPE OPENINGS.
 - DESIRABLY ON THE WIDEST SIDE OF PIT.
 - STEP IRONS CHANGING PIT FACE ARE TO BE PROVIDED WITH 1.2m OVERLAP.
- STEP IRONS TO BE HOT DIP GALVANIZED TO AS4680 AND TO BE STRUCTURAL GRADE 250 IN ACCORDANCE WITH AS3679. ALL EDGES ARE TO BE ROUNDED.
- GATIC PS2-PF POLYPROPYLENE STEPS (OR APPROVED EQUIVALENT) MAY BE USED AND INSTALLED ACCORDING TO THE MANUFACTURERS SPECIFICATIONS.

ì				
Α	13/5/15	ORIGINAL ISSUE	S.W.	S.P.
REV.	DATE	REVISION DESCRIPTION	DRN.	APPD.
GEN				

WENTWORTH SHIRE COUNCIL

WORTH THE DRIVE

STANDARD DRAWINGS STEP IRON DETAILS

TO DRAWING NOT TO BE SCALED.

2. ALL MEASUREMENTS ARE IN MILLIMETRES UNLESS STATED OTHERWISE.

3. FOR UP-TO-DATE DRAWINGS PLEASE CONTACT WENTWORTH SHIRE COUNCIL (WSC) OR CHECK THE WSC WEBSITE. 4. ALL STANDARD DRAWINGS ARE TO BE USED IN CONJUNCTION WITH SD1–1 (STANDARD DRAWINGS CONDITIONS OF USE)

DATE CREATED: 13/5/15 DRG. NO: SD5-7

Α

E:\my documents\0work\0jobs\3WC\standards development\standard drawings\SD5-7 REV A.dwg (04 Nov. 2015) Drawing name: