



SECTION A - A

SECTION B - B

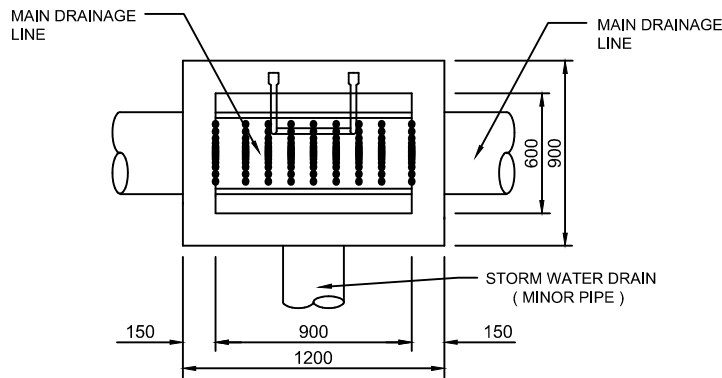

SECTION C - C

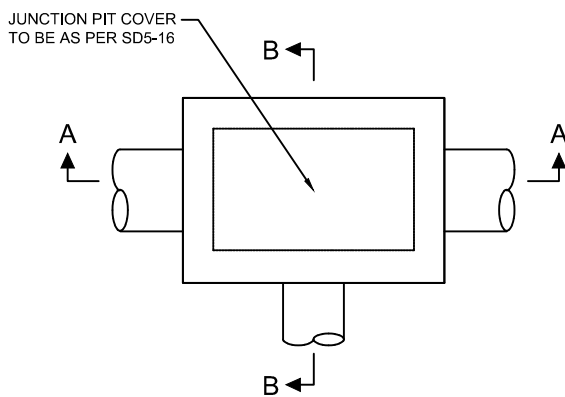

PLAN

NOTES :

1. PITS DEEPER THAN 1000mm TO BE FITTED WITH STEP IRONS IN ACCORDANCE WITH SD5-7.
2. PITS 1500mm DEEP OR GREATER TO BE REINFORCED WITH SL92.
3. MAX DEPTH OF 3600mm FOR THIS PIT TYPE.
4. ALLOWANCE TO BE MADE FOR SUB-SURFACE DRAINS AS SPECIFIED.
5. REINFORCEMENT TO HAVE 50mm COVER.
6. FOR TOP OF PIT AND PIT COVER DETAILS, REFER TO PIT SCHEDULE AND SD5-16.
7. COUNCIL APPROVAL MUST BE OBTAINED FOR THE USE OF PRECAST PITS.
8. MINIMUM CONCRETE STRENGTH OF 25MPa AT 28 DAYS.

Drawing name: E:\my documents\work\3WC\standards development\standard drawings\SD5-8 REV B.dwg (04 Nov, 2015)

REV	DATE	REVISION DESCRIPTION	DRN	APPD
B	21/10/15	MINOR DRAFTING AMENDMENTS	S.W.	S.P.
A	13/5/15	ORIGINAL ISSUE	S.W.	S.P.

GENERAL NOTES:

1. DRAWING NOT TO BE SCALED.
2. ALL MEASUREMENTS ARE IN MILLIMETRES UNLESS STATED OTHERWISE.
3. FOR UP-TO-DATE DRAWINGS PLEASE CONTACT WENTWORTH SHIRE COUNCIL (WSC) OR CHECK THE WSC WEBSITE.
4. ALL STANDARD DRAWINGS ARE TO BE USED IN CONJUNCTION WITH SD1-1 (STANDARD DRAWINGS CONDITIONS OF USE).

**WENTWORTH
SHIRE COUNCIL**
WORTH THE DRIVE

STANDARD DRAWINGS

STORM WATER JUNCTION PIT
FOR PIPES UP TO 600mm DIAMETER
AND 3600mm MAXIMUM DEPTH

DATE CREATED:
22/4/15

DRG. NO:

SD5-8

REV: B